


Poste Trifásico

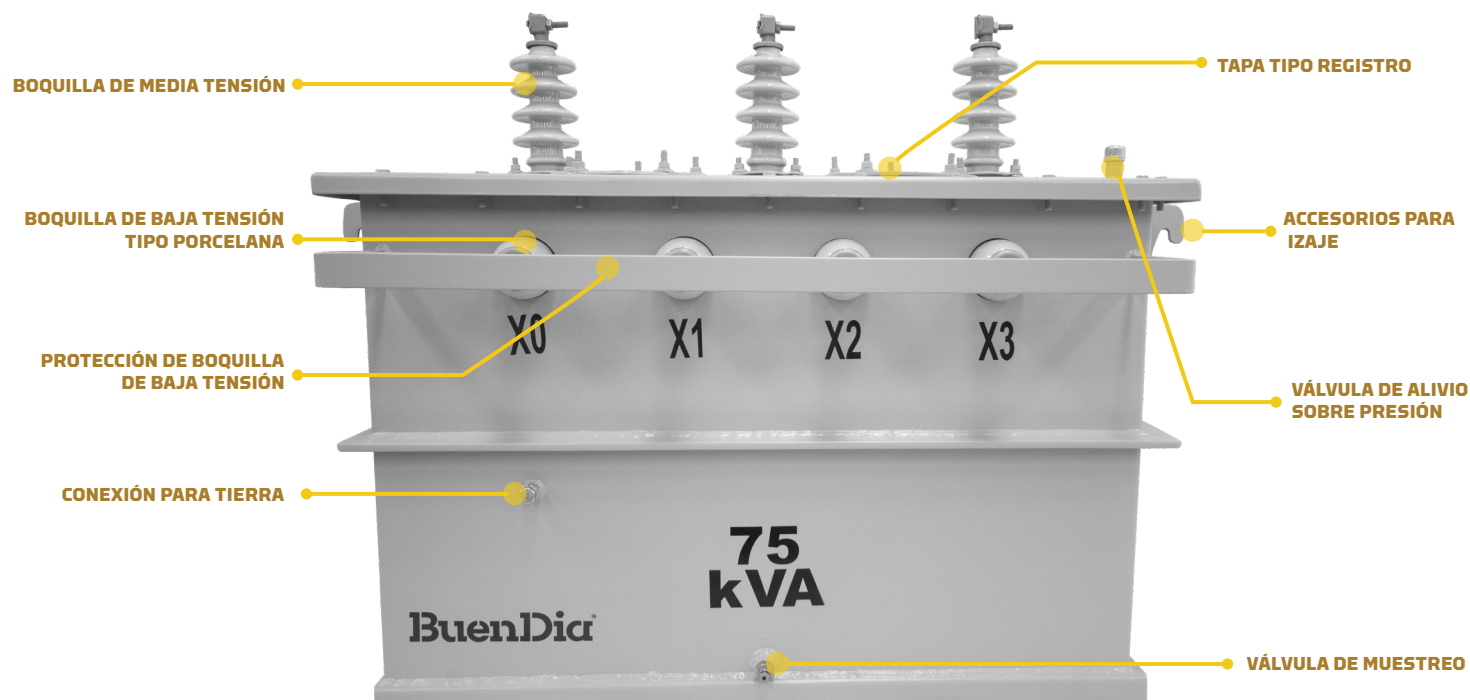

TRANSFORMADOR TIPO POSTE TRIFÁSICO												
NORMA NMX- J- 116 VIGENTE												
CLASE 15 Kv					CLASE 25 kv				CLASE 34.5 kv			
kVA	Pt	%Z	%η	%lex	Pt	%Z	%η	%lex	Pt	%Z	%η	%lex
15	205	2.00-3.00	98.32	2.00	222	2.00-3.25	98.18	2.00	241	2.00-3.50	98.03	2.00
30	336	2.00-3.00	98.62	2.00	365	2.00-3.25	98.50	2.00	403	2.00-3.50	98.35	2.00
45	467	2.00-3.00	98.72	2.00	511	2.00-3.25	98.60	2.00	556	2.00-3.50	98.48	2.00
75	692	2.00-3.00	98.86	1.50	759	2.00-3.25	98.75	1.50	827	2.00-3.50	98.64	1.50
112.5	955	2.00-3.00	98.95	1.50	1047	2.00-3.25	98.85	1.50	1130	2.00-3.50	98.76	1.50
150	1175	2.00-3.00	99.03	1.50	1286	2.00-3.25	98.94	1.50	1384	2.00-3.50	98.86	1.50
225	1708	2.00-5.00	99.06	1.50	1892	2.75-5.50	98.96	1.50	2057	3.00-5.75	98.87	1.50
300	2155	2.00-5.00	99.11	1.50	2375	2.75-5.50	99.02	1.50	2620	3.00-5.75	98.92	1.50
500	3226	2.00-5.00	99.20	1.50	3592	2.75-5.50	99.11	1.50	3918	3.00-5.75	99.03	1.50